


**JNEC SPECIFICATIONS
FOR
STANDARD
HOUSE LOOP**

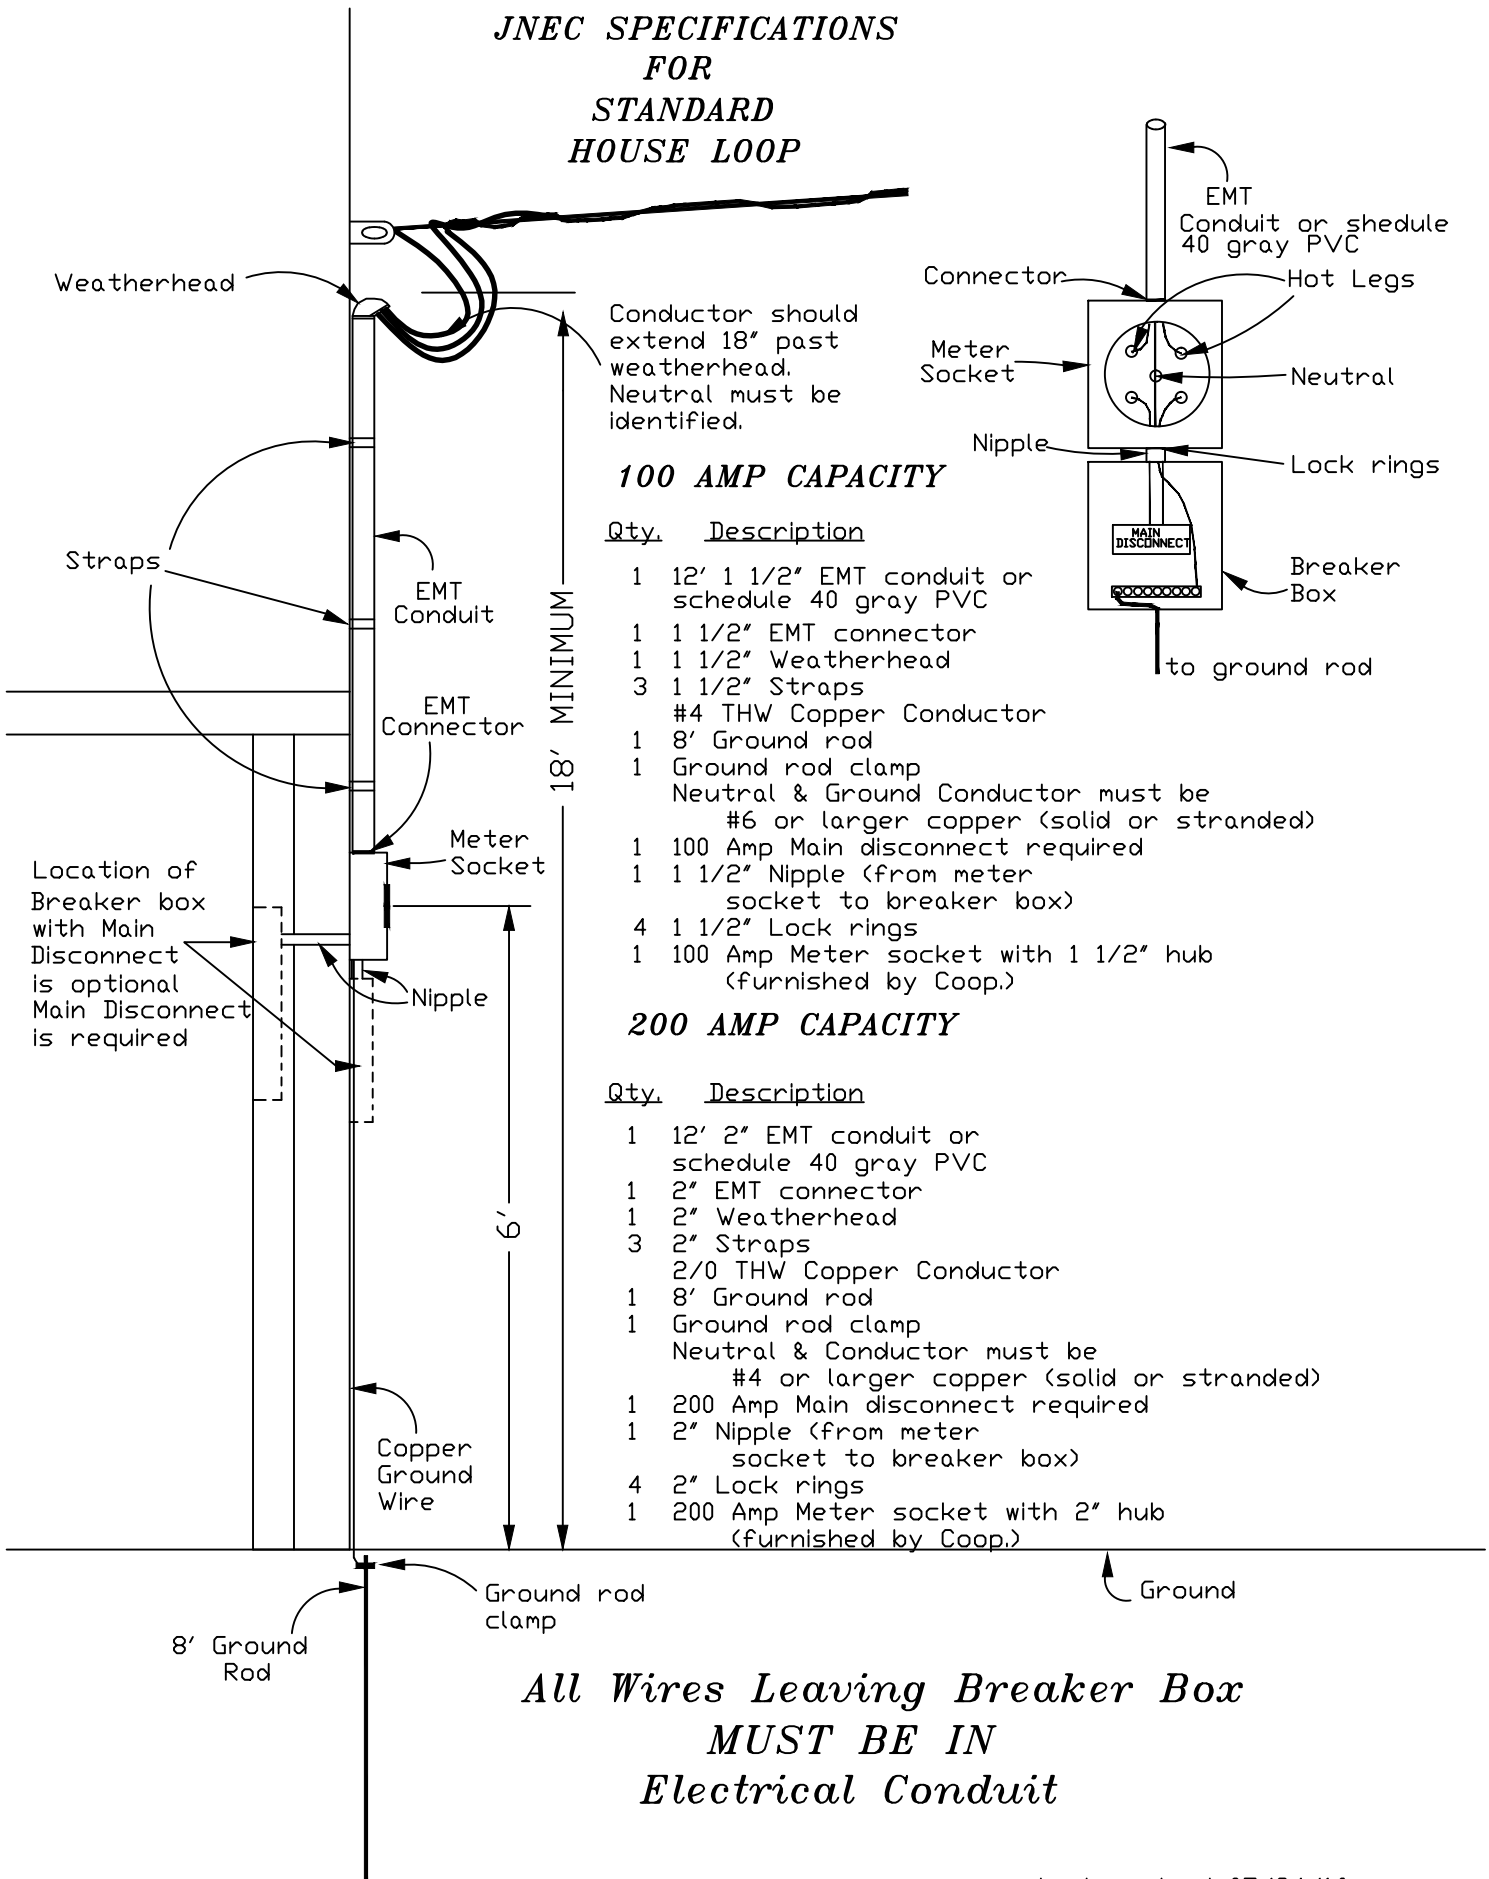

Conductor should extend 18" past weatherhead. Neutral must be identified.

100 AMP CAPACITY

- | Qty. | Description |
|------|--|
| 1 | 12' 1 1/2" EMT conduit or schedule 40 gray PVC |
| 1 | 1 1/2" EMT connector |
| 1 | 1 1/2" Weatherhead |
| 3 | 1 1/2" Straps |
| | #4 THW Copper Conductor |
| 1 | 8' Ground rod |
| 1 | Ground rod clamp |
| | Neutral & Ground Conductor must be #6 or larger copper (solid or stranded) |
| 1 | 100 Amp Main disconnect required |
| 1 | 1 1/2" Nipple (from meter socket to breaker box) |
| 4 | 1 1/2" Lock rings |
| 1 | 100 Amp Meter socket with 1 1/2" hub (furnished by Coop.) |

200 AMP CAPACITY

- | Qty. | Description |
|------|---|
| 1 | 12' 2" EMT conduit or schedule 40 gray PVC |
| 1 | 2" EMT connector |
| 1 | 2" Weatherhead |
| 3 | 2" Straps |
| | 2/0 THW Copper Conductor |
| 1 | 8' Ground rod |
| 1 | Ground rod clamp |
| | Neutral & Conductor must be #4 or larger copper (solid or stranded) |
| 1 | 200 Amp Main disconnect required |
| 1 | 2" Nipple (from meter socket to breaker box) |
| 4 | 2" Lock rings |
| 1 | 200 Amp Meter socket with 2" hub (furnished by Coop.) |

**All Wires Leaving Breaker Box
MUST BE IN
Electrical Conduit**